



EVPU[®]

CERTIFICATE No. 00016/101/1/2018 on February 20th, 2018

Certification body of EVPU a.s. confirms the compliance of the products with requirements of undermentioned standards.

Product: Fire panel

Type: IFP-2.32, IFP-2.8

Specification: 230VAC 50Hz 60mA

Client: ICAS CS s.r.o.

Vyšehradská 2005/8, 128 00 Praha 2, Czech Republic

Identification Code: 40766381

Manufacturer: ICAS AS

Grini Naeringspark 15, 1332 Oesteraas, Norway

Manufacturing facility: ICAS CS s.r.o.

Sportovní 99, 269 01 Rakovník, Czech Republic

Standards: EN 60950-1:2006 + A11:2009 + A1:2010 + A12:2011 + A2:2013

EN 55032:2015

EN 61000-3-2:2014


EN 61000-3-3:2013

EN 50130-4:2011 + A1:2014

Results of tests of mentioned products are summarized in Final report on assessment No. 0-0077/18/C of February 20th, 2018.

Used standards are harmonized with directives of the European parliament and of the Council 2014/35/EU transposed into Slovak government decree No. 148/2016 Z. z. and 2014/30/EU transposed into Slovak government decree No. 127/2016 Z. z.

Validity of certificate
is limited for the period
from: February 20th, 2018
until: February 19th, 2021

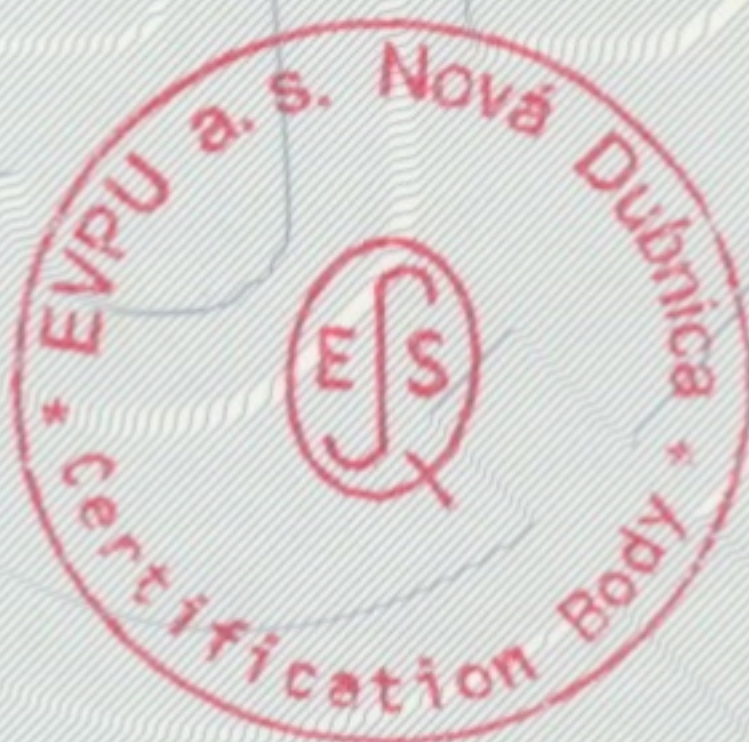

Marek H u d á k

Any significant changes in the design or construction of the products or amendments of the technical decrees reference above may render this Certificate invalid. The product liability rests with the manufacturer or his representative.

053256

EVPU a.s., Trenčianska 19, 018 51 Nová Dubnica, Slovak republic, www.evpu.sk