
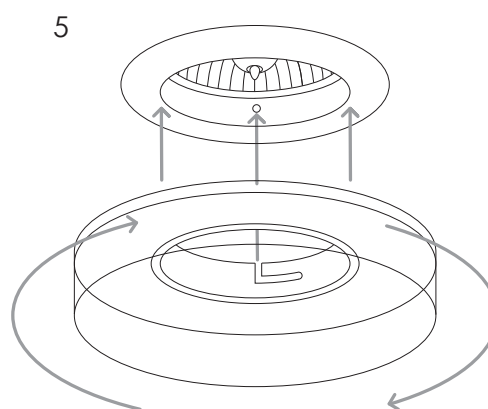
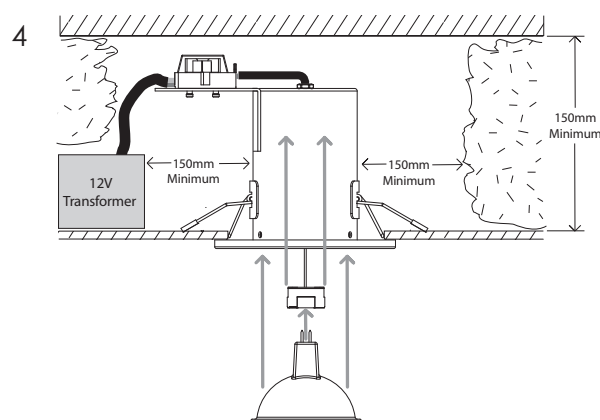
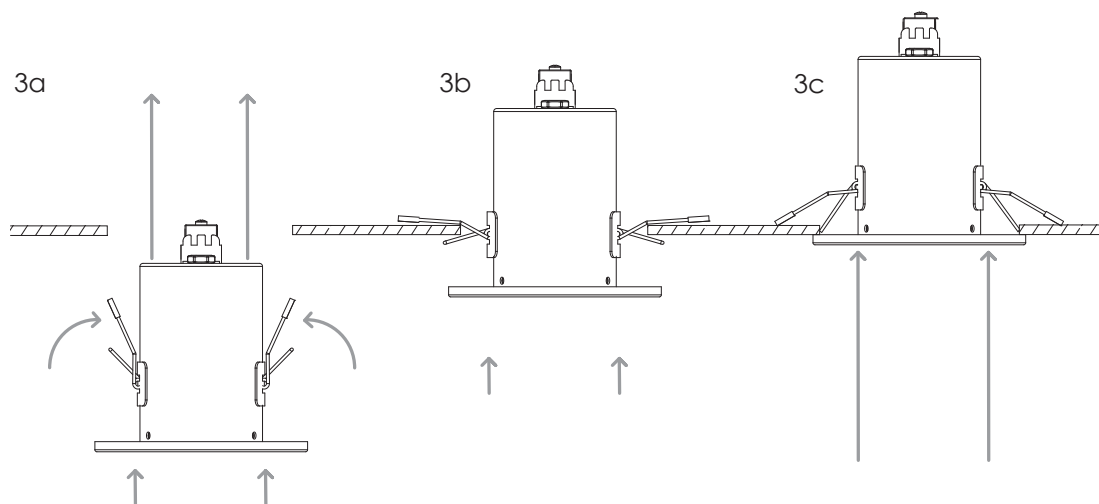


Please read all instructions carefully before commencing assembly.  
These light fittings conform to BS EN 60598

Shower Downlights, These can be used in Bathroom Zones 1, 2 & 3  
For ceiling use only (Rated IP65 Sprayproof)

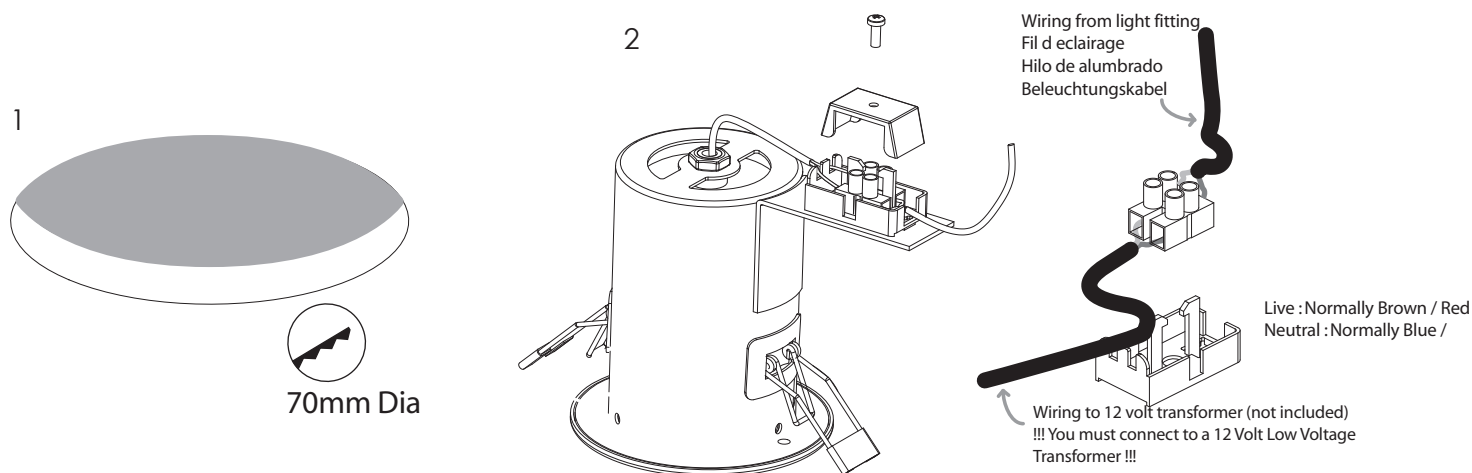

Astro Lighting downlighters are suitable for installation in gypsum wall board ceilings to timber floors that require up to 90min fire resistance to BS 476 :Part 21 : 1987 or BS EN 1365-2 : 2000.  
The specifier must check with the board manufacturer that the ceiling and floor system without downlighters will achieve the required fire resistance period + 10%.