




ARTIKELNR./ ARTICLE NO. E2466292	
MÄRKSTRÖM/ CURRENT RATING 63 A	
MEASURING EQUIPMENT	
CURR- TRAFO- SPACE	ENERGY- METER- SPACE
FAST ANSLUTNING/ FIXED CONNECTIONS	
<125A >125A	
CEE-OUTLETS 3-POLE/230V	
16A	32A 63A 125A
SCHUKO OUTLETS 2-POLE/230V 16A	
6	
CEE-OUTLETS 5-POLE/400V	
16A	32A 63A 125A
2	2 1
JFB/RCCB	
<0,03A	>0,03A & <0,3A
3	1
JFB/RCCB Variable	
VIKT/WEIGHT	
25 kg	

This drawing is property of El-Björn. May not be copied, shown or distributed without our written permission.

UTTAGSCENTRAL
UF 63S/6221-301 EN SE

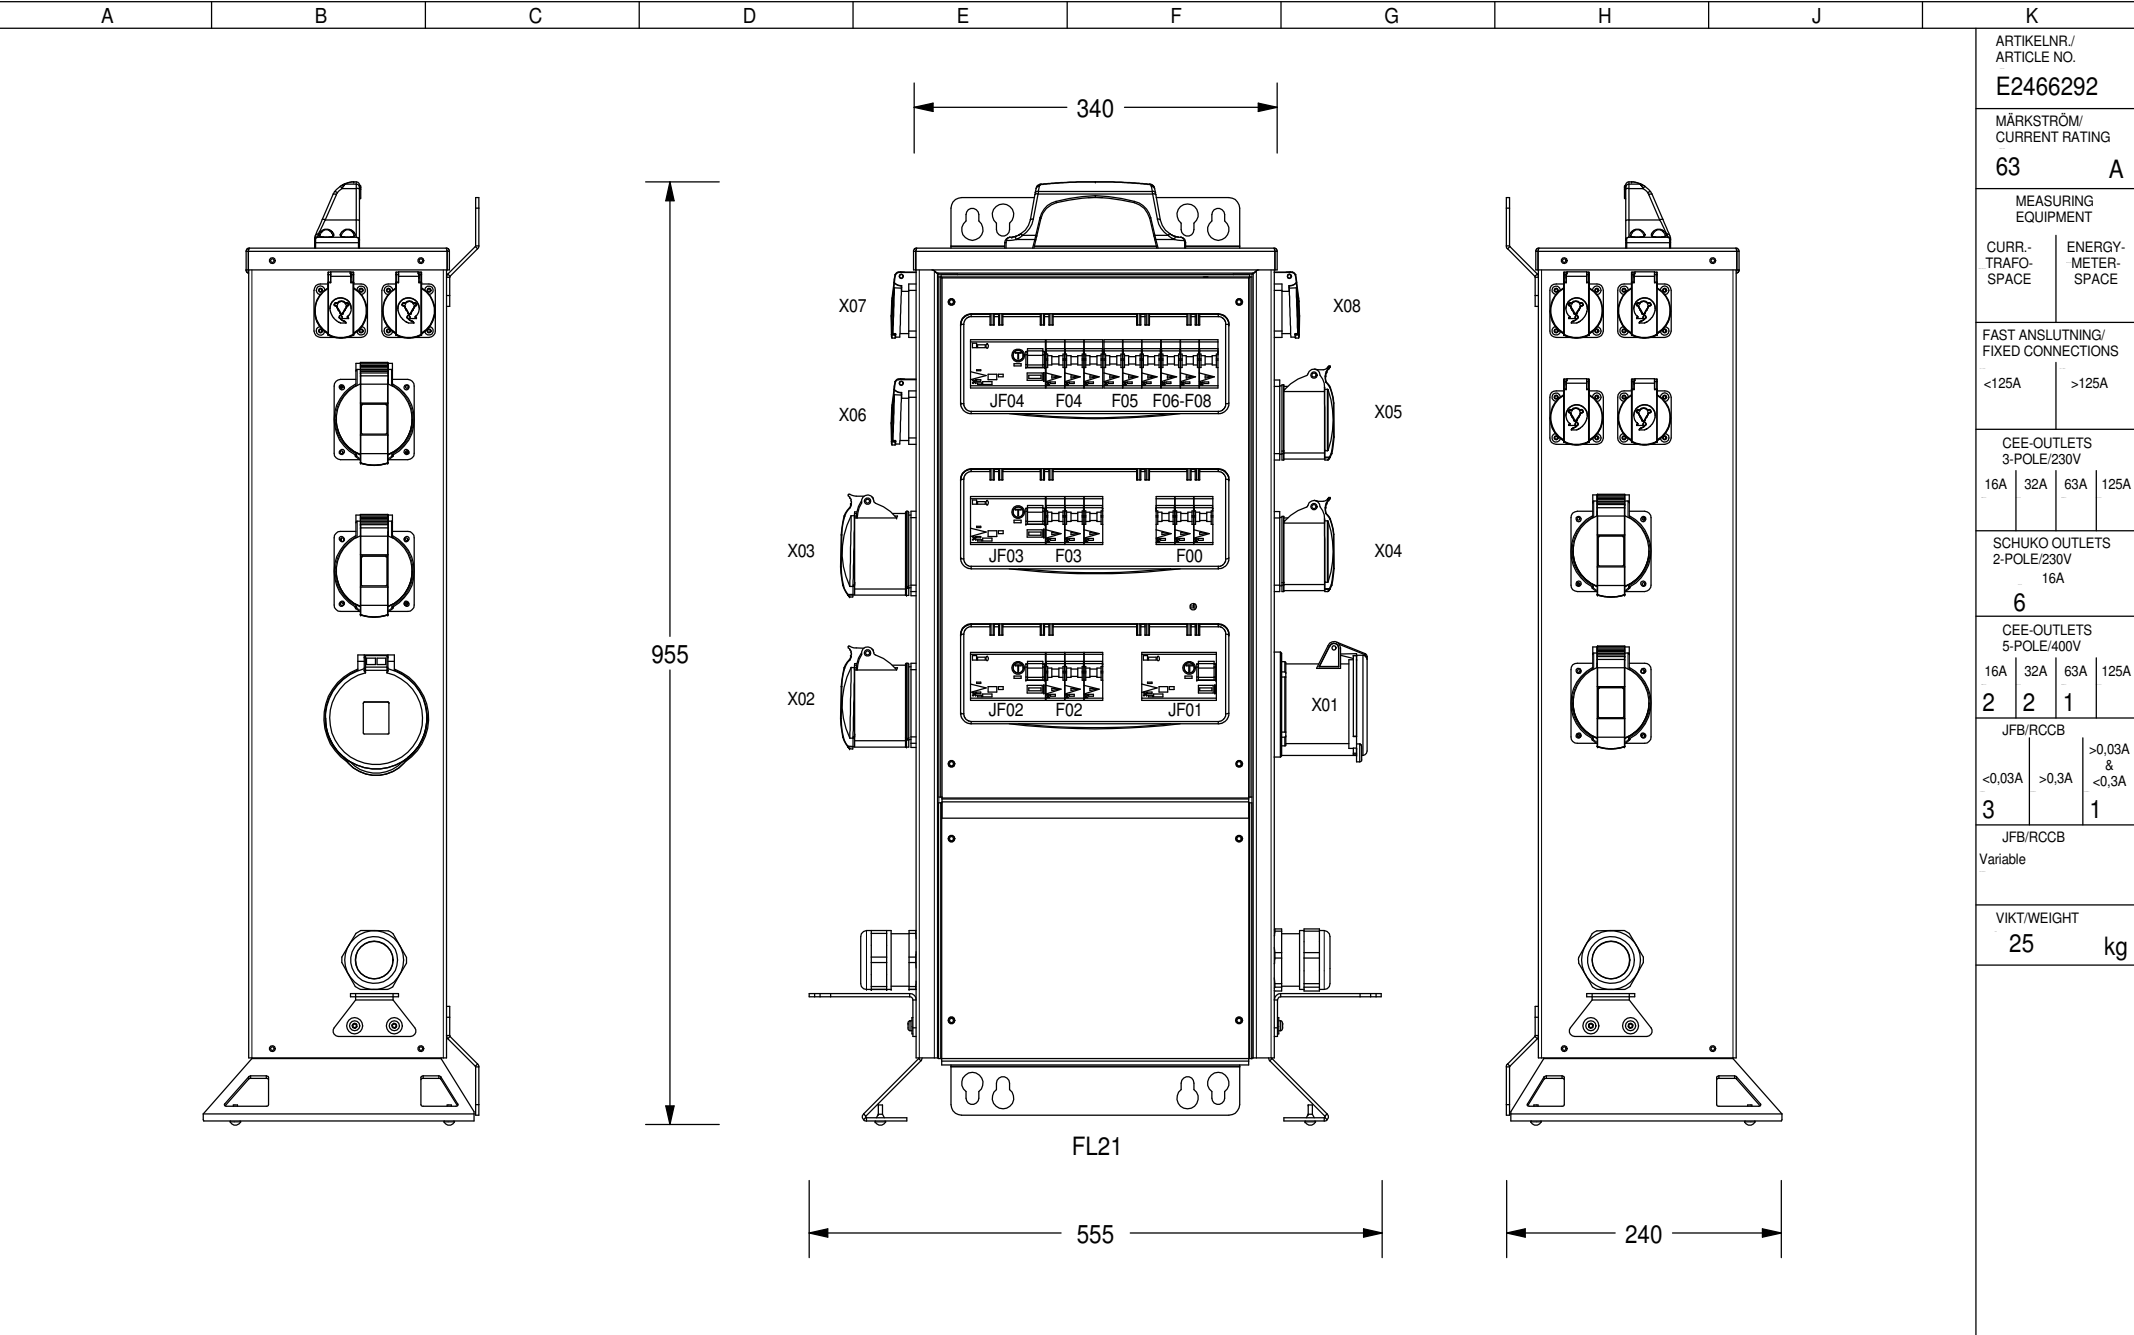

www.elbjorn.com

RITAD AV/DRAWN BY CG	DATUM/DATE 140506	NEXT SHEET 2	SHEET 1
SIGN	REVISION/ISSUE A*	RITINGS NR./DRAWING E2466292	

A	B	C	D	E	F	G	H	J	K	
The diagram illustrates a single-phase electrical distribution system. A main supply line enters from the left, passing through a main switch F00 (C 63A) and a terminal block X00 (AL/CU 2x16-95, MAX FÖRSÄK. 125A). This line then branches into four parallel vertical branches, each protected by a JF circuit breaker (JF01, JF02, JF03, JF04) with ratings of 63A/300mA, 40A/30mA, 40A/30mA, and 63A/30mA respectively. Each JF branch contains an F circuit breaker (F02-F08) and a terminal block (X01-X08). The F circuit breakers have ratings of 32A (F02, F03), 16A (F04, F05, F06, F07, F08), and 16A (F04). The terminal blocks are labeled with their respective outlet types: X01 (CEE 463-6), X02 (CEE 432-6), X03 (CEE 432-6), X04 (CEE 416-6), X05 (CEE 416-6), X06 (SCHUKO SCHUKO), X07 (SCHUKO SCHUKO), and X08 (SCHUKO SCHUKO). The diagram also shows grounding symbols and a neutral line.									ARTIKELNR/ ARTICLE NO. E2466292 MÄRKSTRÖM/ CURRENT RATING 63A MEASURING EQUIPMENT CURR- TRAFO- SPACEENERGY- METER- SPACE FAST ANSLUTNING/ FIXED CONNECTIONS <125A>125A CEE-OUTLETS 3-POLE/230V 16A32A63A125A SCHUKO OUTLETS 2-POLE/230V 16A 6 CEE-OUTLETS 5-POLE/400V 16A32A63A125A 221 JFB/RCCB <0,03A>0,03A>0,3A<0,3A 31 JFB/RCCB Variable VIKT/WEIGHT 25kg	
This drawing is property of El-Björn. May not be copied, shown or distributed without our written permission.				UTTAGSCENTRAL UF 63S//6221-301 EN SE		EL-BJÖRN www.elbjorn.com		RITAD AV/DRAWN BY CG SIGN	DATUM/DATE 140506 REVISION/ISSUE A*	NEXT SHEET 3 SHEET 2

This drawing is property of El-Björn. May not be copied, shown or distributed without our written permission.